



USP: Add Up Stream Protection, Facility ID, and Blocking Device Type  
USP:  
USP:  
USP:  
USP:




Safety Reminders / Adverse Conditions  
?:  
?:  
?:  
?:



Work Zone General Comments: Double click to edit

REMEMBER: Work zone area conditions may have changed for this job! Everyone is responsible for verifying the above safety information is correct prior to any work being performed each day.

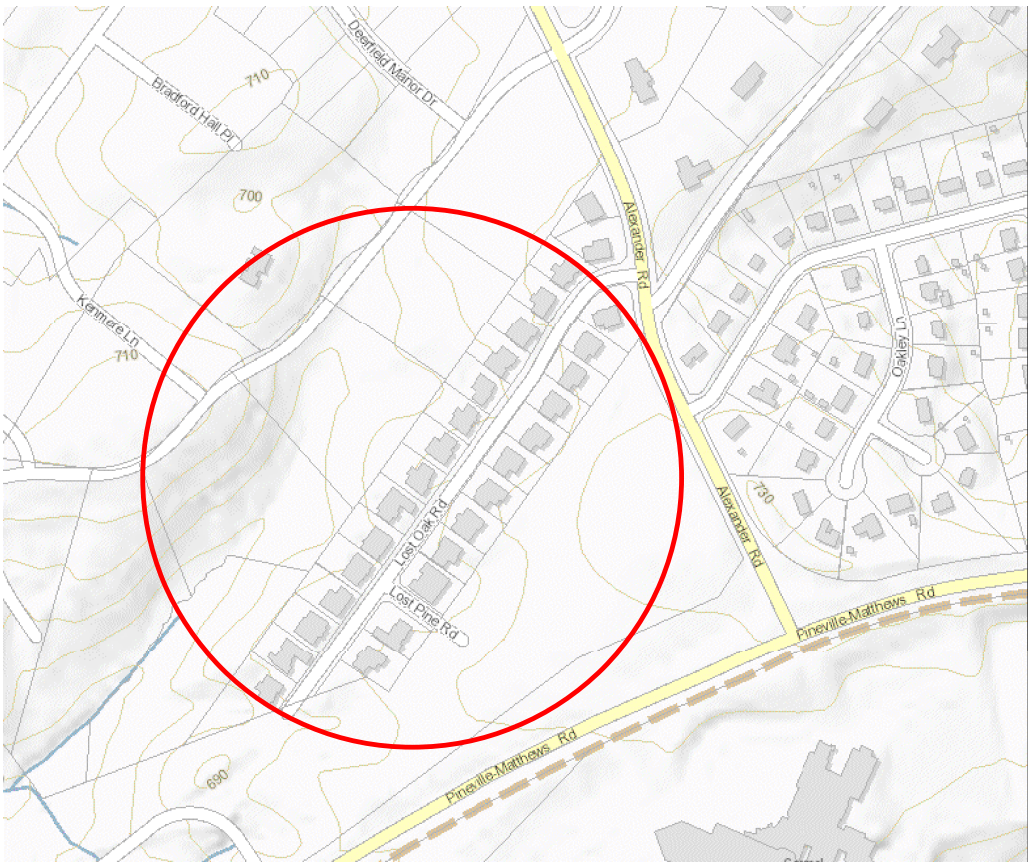

VICINITY MAP

- Proposed 100 watt HPS Traditional fixture and 12' D.B. black fiberglass deco pole
- Proposed 6/2 underground secondary cable
- Approximate illumination coverage of 100 watt fixture
- Existing single phase pad mouted transformer